



PA-SHT REV 5

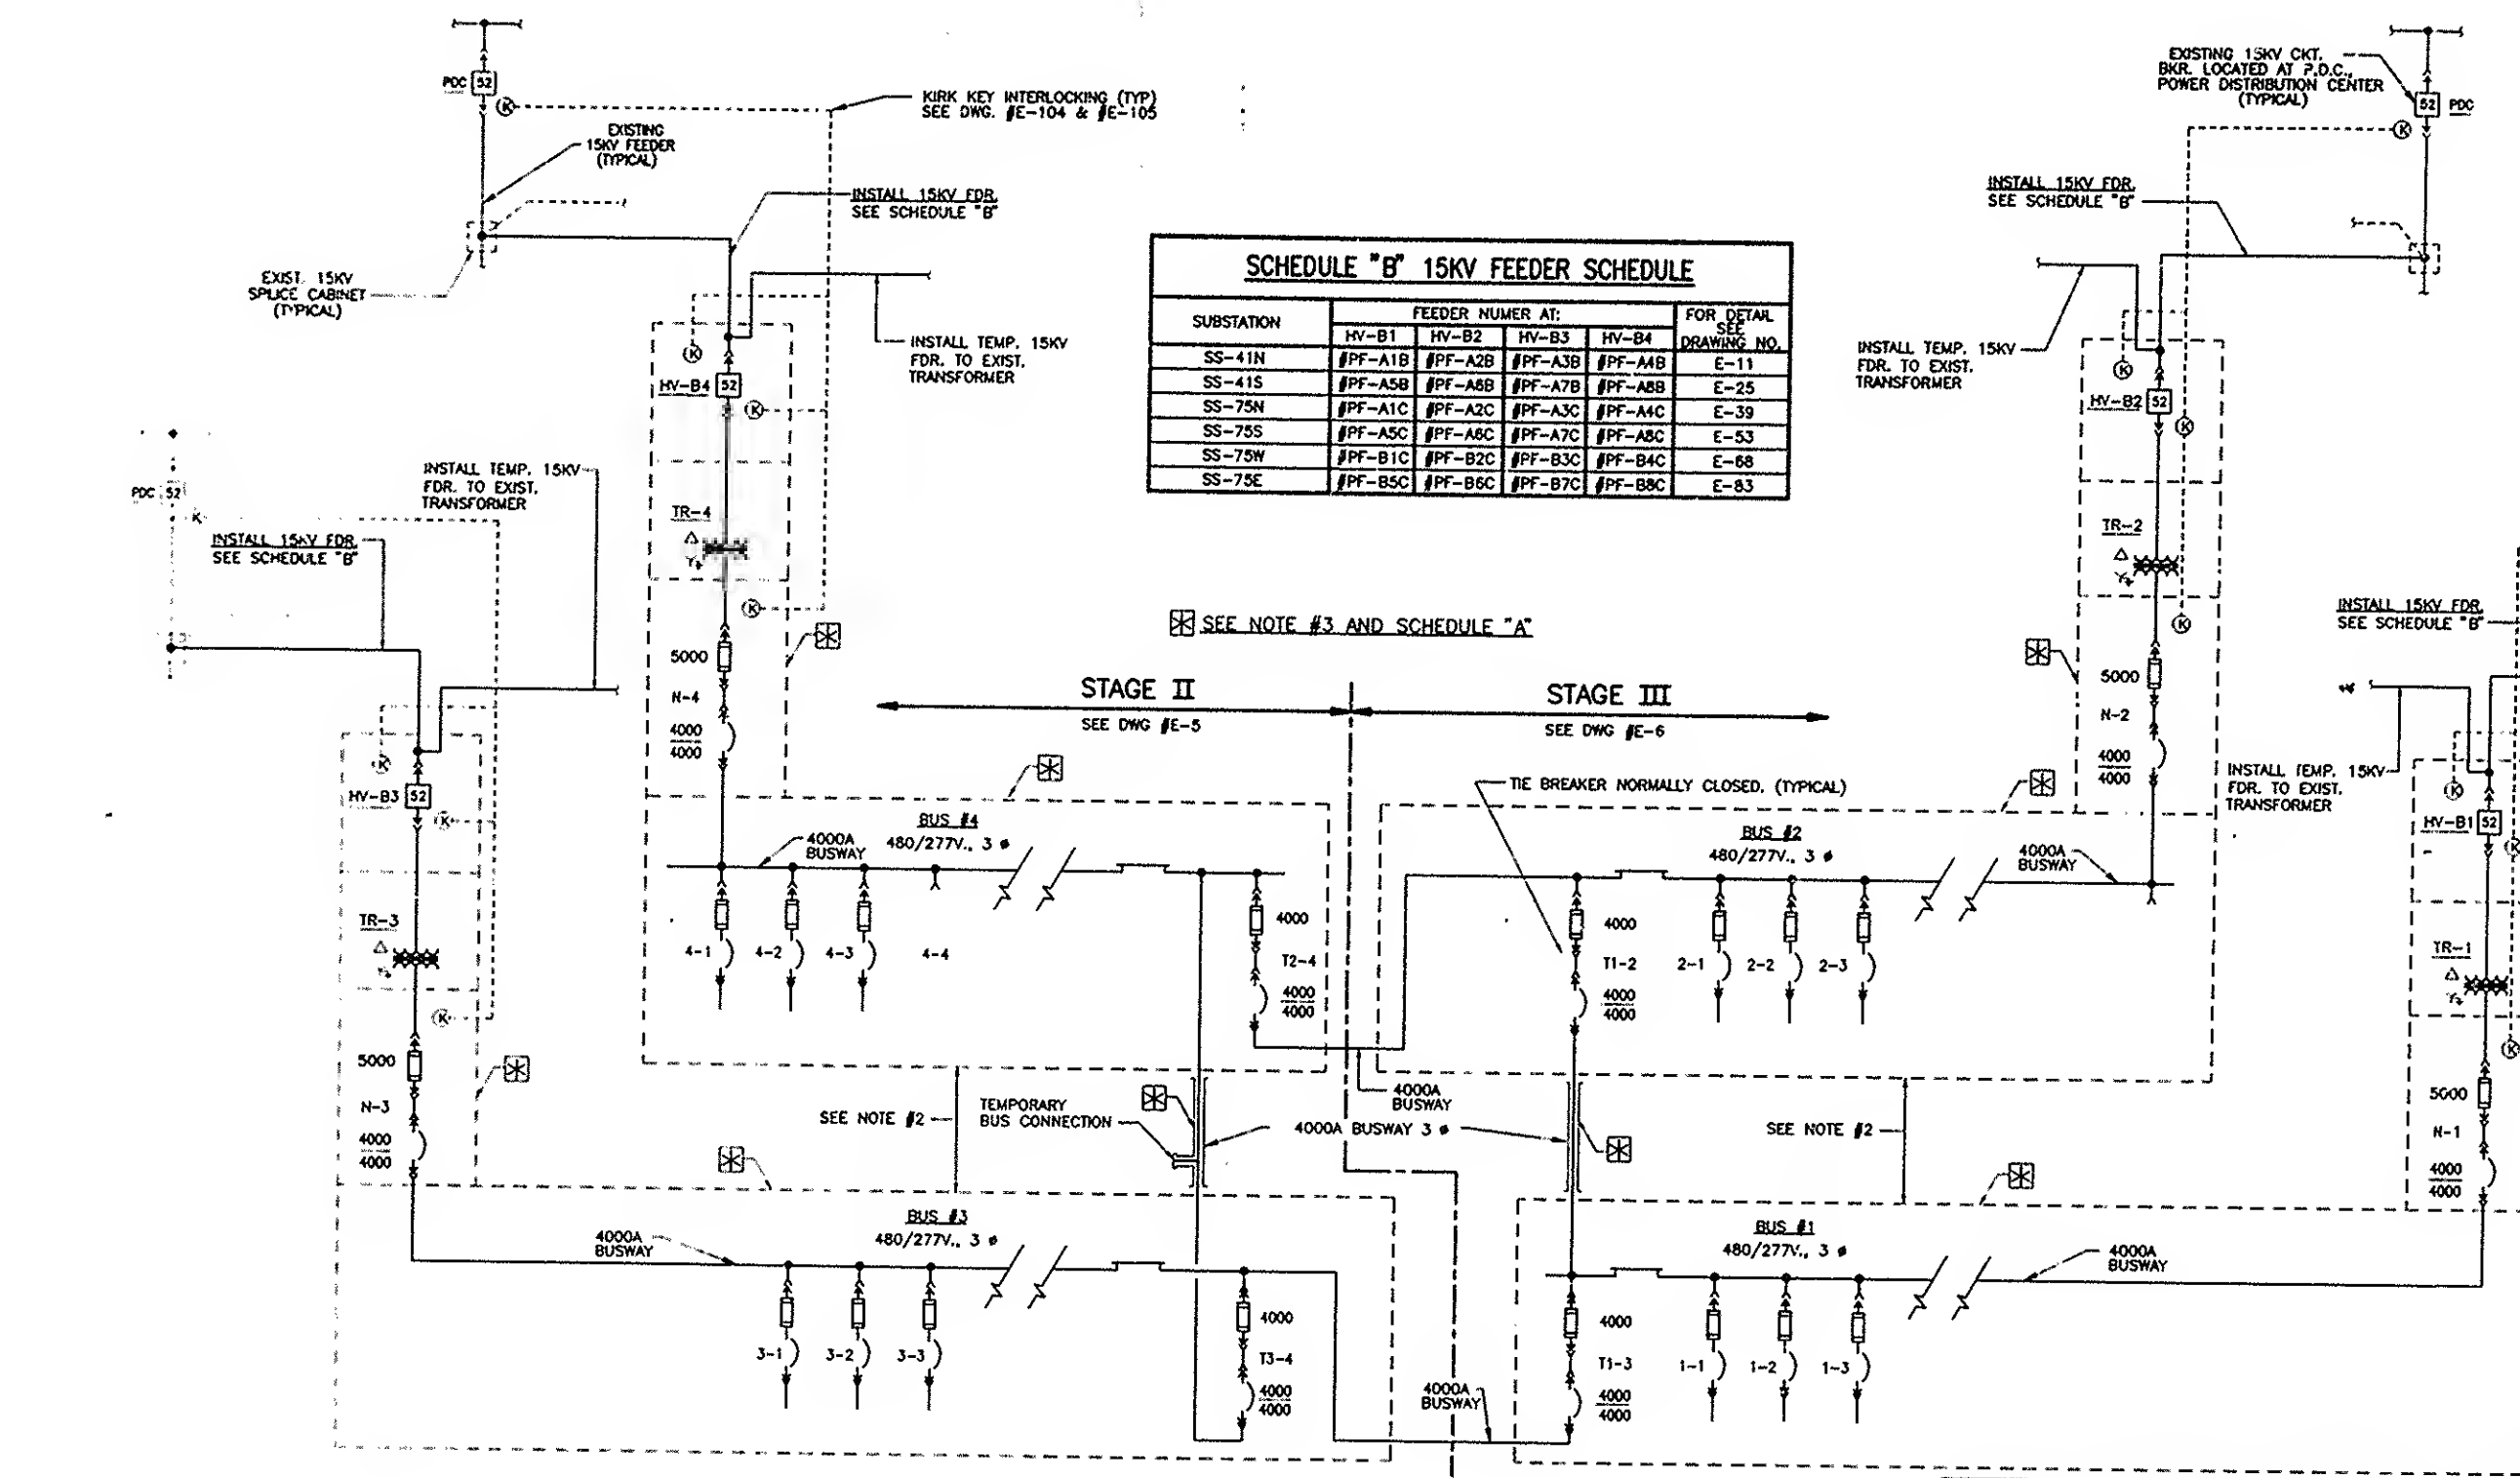

SCHEDULE "B" 15KV FEEDER SCHEDULE				
SUBSTATION	FEEDER NUMBER AT:			
	HV-B1	HV-B2	HV-B3	HV-B4
SS-41N	#PF-A1B	#PF-A2B	#PF-A3B	#PF-A4B
SS-41S	#PF-A5B	#PF-A6B	#PF-A7B	#PF-A8B
SS-75N	#PF-A1C	#PF-A2C	#PF-A3C	#PF-A4C
SS-75S	#PF-A5C	#PF-A6C	#PF-A7C	#PF-A8C
SS-75W	#PF-B1C	#PF-B2C	#PF-B3C	#PF-B4C
SS-75E	#PF-B5C	#PF-B6C	#PF-B7C	#PF-B8C

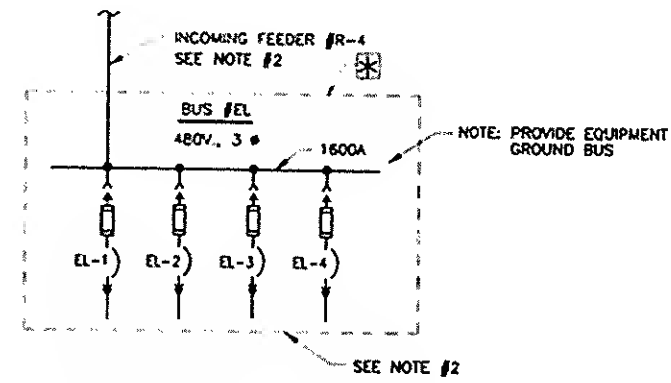

ONE LINE DIAGRAM - BUS #EL

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE CONTRACT DRAWINGS, CONSTITUTING A PART OF CONTRACT NO. **WTC-802.071** IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT THE TIME THE SAID CONTRACT WAS EXECUTED BY THE PARTIES.

DATE **6/21/95** **Sullivan A. Adams** SPEC. WRITER
DATE **8/15/95** **Peter K. [Signature]** ENGINEER OF DESIGN

SCHEDULE "A" - EQUIPMENT FURNISHMENT									
LOCATION			DESIGNATION	EQUIPMENT					
				HV-B (MEDIUM VOLTAGE) (13.8KV) - SWGR. SECT.	G&T (13.8KV GND. & TEST DEVICE)		TR (13.8KV) - SWGR. SECT.		HV-DIST. - 48 IN. DRY TYPE
TOWER ONE	41st FLOOR	NORTH	SS-41N	4	1	4			
		SOUTH	SS-41S	4	1	4			
	75th FLOOR	NORTH	SS-75N	4	1	4			
		SOUTH	SS-75S	4	1	4			
TOWER TWO	75th FLOOR	WEST	SS-75W	4	1	4			
		EAST	SS-75E	4	1	4			
			SPARE	-	-	1			
			TOTAL	24	8	25	1		